
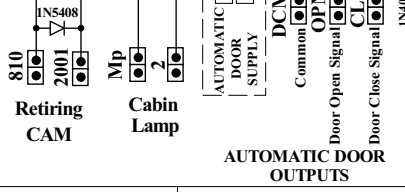
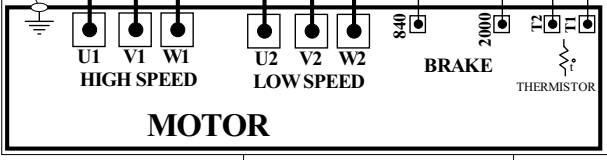
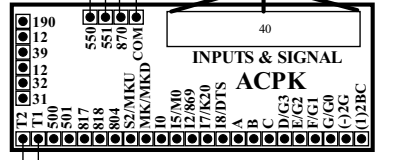
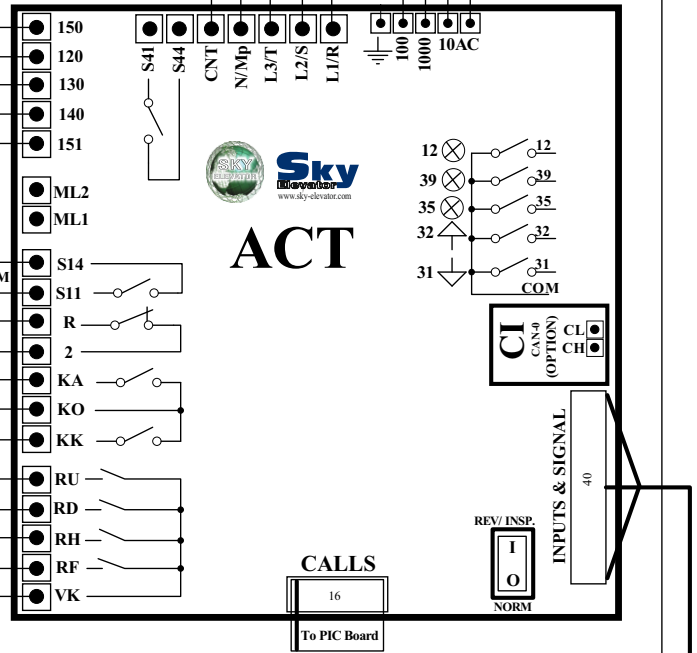


*TRANSFORMER : Until 8 stops, use 200W transformer.
For 9-16 stops, use 250W transformer.(0-18-20V coil must be 130W)

*TRANSFORMER / 200W

SAFETY LINE

*EEKS : Emergency Electrical Operator.



This document is a sample for applications. All information contained in these materials are subject to change by SKY ELEVATOR without notice. SKY ELEVATOR assumes no responsibility for any damage, liability, or other loss rising from these inaccuracies or errors.

F/7.5.5.02.69

CONTACTOR AND MOTOR CONNECTIONS
SAFETY VOLTAGE: 48V DC

SKY ELEVATOR	SERIES	SKY 311 (ACT)	DRW.	SKY
	PROJ.	SKY 311 (ACT)	APPRV.	SKY
	REV.	00	DATE	11 APR 2013